



Designation: C667 – 17 (Reapproved 2022)

Standard Specification for Prefabricated Reflective Insulation Systems for Equipment and Pipe Operating at Temperatures above Ambient Air¹

This standard is issued under the fixed designation C667; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon (ϵ) indicates an editorial change since the last revision or reapproval.

1. Scope

1.1 This specification covers the requirements for all metal prefabricated, reflective insulation systems for equipment and piping operating in air at temperatures above ambient. Typical applications are in nuclear power-generating plants and industrial plants.

1.2 Reflective insulation is thermal insulation that reduces radiant heat transfer across spaces by the use of surfaces of high reflectance and low emittance.

1.3 The values stated in inch-pound units are to be regarded as standard. The values given in parentheses are mathematical conversions to SI units that are provided for information only and are not considered standard.

1.4 *This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety, health, and environmental practices and determine the applicability of regulatory limitations prior to use.*

1.5 *This international standard was developed in accordance with internationally recognized principles on standardization established in the Decision on Principles for the Development of International Standards, Guides and Recommendations issued by the World Trade Organization Technical Barriers to Trade (TBT) Committee.*

2. Referenced Documents

2.1 ASTM Standards:²

- C168 Terminology Relating to Thermal Insulation
- C335 Test Method for Steady-State Heat Transfer Properties of Pipe Insulation
- C411 Test Method for Hot-Surface Performance of High-Temperature Thermal Insulation

¹ This specification is under the jurisdiction of ASTM Committee C16 on Thermal Insulation and is the direct responsibility of Subcommittee C16.40 on Insulation Systems.

Current edition approved Sept. 1, 2022. Published October 2022. Originally approved in 1992. Last previous edition approved in 2017 as C667 – 17. DOI: 10.1520/C0667-17R22.

² For referenced ASTM standards, visit the ASTM website, www.astm.org, or contact ASTM Customer Service at service@astm.org. For *Annual Book of ASTM Standards* volume information, refer to the standard's Document Summary page on the ASTM website.

- C835 Test Method for Total Hemispherical Emittance of Surfaces up to 1400°C
- C854 Test Method for Resistance to External Loads on Metal Reflective Pipe Insulation (Withdrawn 1997)³
- C1045 Practice for Calculating Thermal Transmission Properties Under Steady-State Conditions
- C1058 Practice for Selecting Temperatures for Evaluating and Reporting Thermal Properties of Thermal Insulation
- C1061 Test Method for Thermal Transmission Properties of Non-Homogeneous Insulation Panels Installed Vertically (Withdrawn 1995)³
- C1371 Test Method for Determination of Emittance of Materials Near Room Temperature Using Portable Emis-someters

3. Terminology

3.1 Definitions:

3.1.1 Terms relating to thermal insulation materials and testing are in accordance with Terminology C168.

3.2 Definitions of Terms Specific to This Standard:

3.2.1 *convection stops, n*—seals used to reduce convection losses.

3.2.2 *end supports, n*—structural members placed at the end of a unit of insulation and fastened to both the inner and outer case.

3.2.2.1 *Discussion*—The primary purpose of the end supports is to increase the structural integrity of the unit.

3.2.3 *inner case, n*—the innermost sheet of the unit of insulation (closest to the hot surface).

3.2.3.1 *Discussion*—The inner case may perform structural functions in addition to its thermal functions.

3.2.4 *insulation assembly, n*—an assembly of insulation units arranged and secured together in a prescribed order that comprises the complete insulation for a vessel, pump, pipeline, or other component for a single design objective.

3.2.5 *insulation system, n*—a collection of insulation assemblies, that when secured together in a prescribed order, comprises the complete insulation for a vessel, pump, pipeline, or other component for a single design objective.

³ The last approved version of this historical standard is referenced on www.astm.org.

3.2.6 *lap straps, n*—strips that overlap a longitudinal or circumferential joint in the insulation which aligns adjacent insulation units and may also serve to restrict air infiltration and convection losses and to shed external falling water.

3.2.6.1 *Discussion*—The lap straps may be integral with one piece of the outer case or separate strips secured to it.

3.2.7 *outer case, n*—the outermost sheet or the unit of insulation (farthest from the hot surface). It usually performs structural functions in addition to its thermal functions.

3.2.8 *penetrations, n*—openings in a unit of insulation from the cold surface through to the hot surface.

3.2.9 *reflective liners, n*—those reflective sheets or foil interposed between the inner and outer case to reflect radiant energy, to minimize emission of radiant energy, and to restrict internal convection.

3.2.10 *thickness, n*—(see Fig. 1).

3.2.11 *unit of insulation, n*—a single structurally independent assembly of inner case, outer case, reflective liners, and end supports (if required).

3.3 *Symbols:*

3.3.1 The symbols used in this specification have the following significance:

3.3.2 C_c, n —conductance based on the area of insulation at the cold surface.

4. Ordering Information

4.1 Ordering information shall include the following:

4.1.1 Service requirements including operating hot surface temperature, expected ambient temperatures, and ambient air velocities,

4.1.2 Expected service life and any special environmental exposures,

4.1.3 Permitted average thermal conductance based on hot pipe temperature and insulation cold surface temperature,

4.1.4 Personnel exposure surface temperature limitations,

4.1.5 Expected seismic, loading, and vibration exposures,

4.1.6 Purchaser's systems and equipment drawings,

4.1.7 Limits, if any, on size, maximum thickness, weight, or number of insulation units requiring removal for inspection,

4.1.8 Location of components or maintenance, or both, and systems requiring removal of units for inspections,

4.1.9 Any unusual operating or test conditions, and

4.1.10 Cleanliness level required.

5. Materials and Manufacture

5.1 Each insulation unit is a rigid, self-contained, prefabricated metal construction comprised of an inner casing and an outer casing, and if needed, one or more reflective liners supported and spaced so as to minimize internal convection and conduction. These parts are arranged to form a durable rigid assembly with separated air spaces between the inner and outer casing and the individual reflective liners.

5.2 The reflective insulation described herein is limited to systems of insulating units, designed by the manufacturer to fit

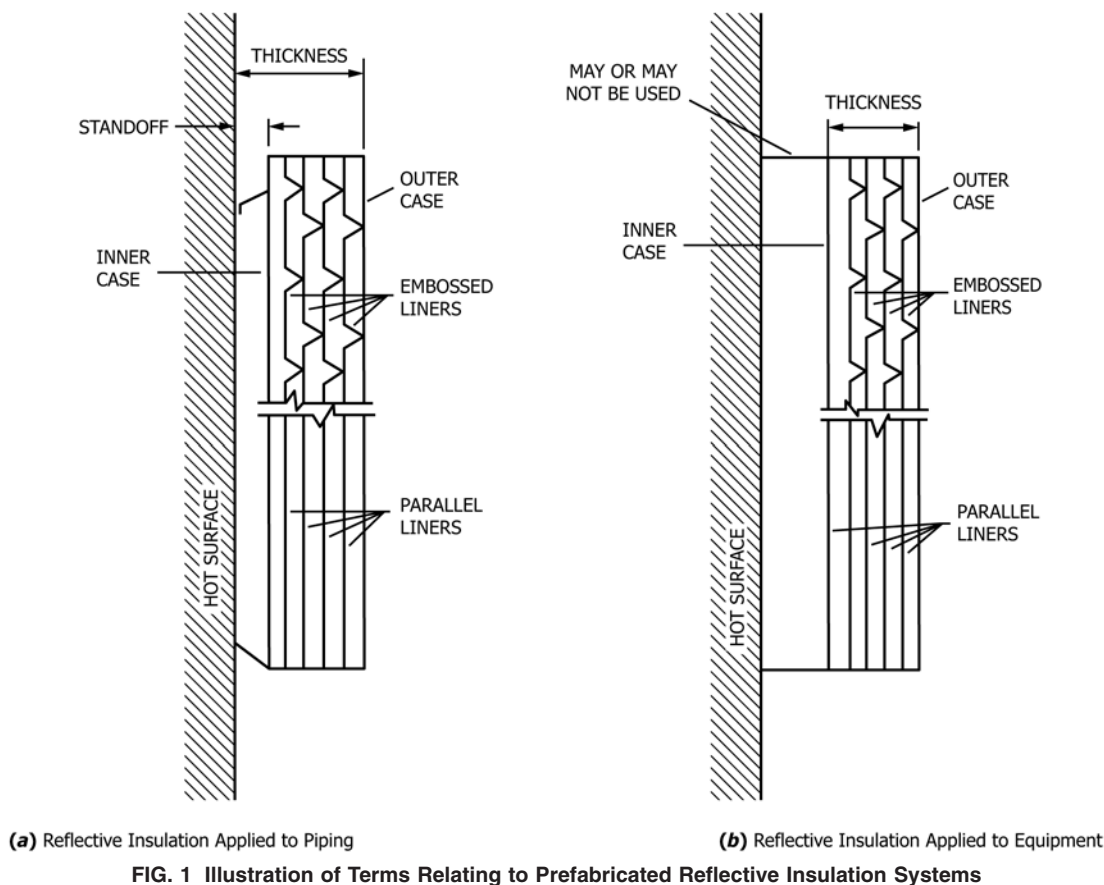


FIG. 1 Illustration of Terms Relating to Prefabricated Reflective Insulation Systems