



Designation: D5632/D5632M – 17 (Reapproved 2022)

Standard Specification for Halon 1301, Bromotrifluoromethane (CF₃Br)¹

This standard is issued under the fixed designation D5632/D5632M; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon (ε) indicates an editorial change since the last revision or reapproval.

This standard has been approved for use by agencies of the U.S. Department of Defense.

1. Scope

1.1 This specification covers the requirements for Halon 1301 as a fire-fighting medium.

1.2 This specification does not address the fire-fighting equipment or hardware that employs Halon 1301 or the conditions of employing such equipment (for example, handhelds, fixed installations, etc.).

1.3 This specification does not address the storage or transportation of Halon 1301. Storage, handling, and transportation issues are addressed in Practice D5631.

1.4 The values stated in either SI units or inch-pound units are to be regarded separately as standard. The values stated in each system are not necessarily exact equivalents; therefore, to ensure conformance with the standard, each system shall be used independently of the other, and values from the two systems shall not be combined.

1.5 The following safety hazards caveat pertains only to the test methods portion, Section 6, of this specification: *This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety, health, and environmental practices and determine the applicability of regulatory limitations prior to use.* Specific hazards statements are given in 4.5.

1.6 *This international standard was developed in accordance with internationally recognized principles on standardization established in the Decision on Principles for the Development of International Standards, Guides and Recommendations issued by the World Trade Organization Technical Barriers to Trade (TBT) Committee.*

¹ This specification is under the jurisdiction of ASTM Committee D26 on Halogenated Organic Solvents and Fire Extinguishing Agents, and is the direct responsibility of Subcommittee D26.09 on Fire Extinguishing Agents.

Current edition approved Nov. 1, 2022. Published November 2022. Originally approved in 1994. Last previous edition approved in 2017 as D5632/D5632M-17. DOI: 10.1520/D5632_D5632M-17R22.

2. Referenced Documents

2.1 *ASTM Standards*:²

D2108 Test Method for Color of Halogenated Organic Solvents and Their Admixtures (Platinum-Cobalt Scale)

D5631 Practice for Handling, Transportation, and Storage of Halon 1301, Bromotrifluoromethane (CF₃Br)

2.2 *ISO Standard*:³

ISO 3427 Gaseous Halogenated Hydrocarbons (Liquefied Gases)—Taking of a Sample

2.3 *AHRI Standard*:⁴

2008 Appendix C for Analytical Procedures for AHRI Standard 700-2014

2.4 *U.S. Government Standard*:⁵

CFR Title 49, Part 172 U.S. DOT Hazardous Materials Table, Special Provisions, Hazardous Materials Communications, Emergency Response Information, and Training Requirements

3. Terminology

3.1 *Definitions of Terms Specific to This Standard*:

3.1.1 *Halon 1301*—The halogenated hydrocarbon compound Bromotrifluoromethane used as a fire extinguishing medium.

3.1.1.1 *Discussion*—The halon terminology system provides a convenient means to reference halogenated hydrocarbon fire extinguishants. Halogenated hydrocarbons are acyclic saturated hydrocarbons in which one or more of the hydrogen atoms have been replaced by atoms from the halogen series (that is, fluorine, chlorine, bromine, and iodine). By definition, the first digit of the halon numbering system represents the

² For referenced ASTM standards, visit the ASTM website, www.astm.org, or contact ASTM Customer Service at service@astm.org. For *Annual Book of ASTM Standards* volume information, refer to the standard's Document Summary page on the ASTM website.

³ Available from American National Standards Institute (ANSI), 25 W. 43rd St., 4th Floor, New York, NY 10036, <http://www.ansi.org>.

⁴ Available from Air-Conditioning, Heating, and Refrigeration Institute (AHRI), 2111 Wilson Blvd, Suite 500, Arlington, VA 22201, <http://www.ahrinet.org>.

⁵ Available from U.S. Government Publishing Office (GPO), 732 N. Capitol Street, NW, Washington, DC 20401-0001, <http://www.gpo.gov>.

number of carbon atoms in the compound molecule; the second digit, the number of fluorine atoms; the third digit, the number of chlorine atoms; the fourth digit, the number of bromine atoms; and the fifth digit, the number of iodine atoms. Trailing zeros are not expressed. Unaccounted for valence requirements are assumed to be hydrogen atoms.

$$\text{number of hydrogen atoms} = \quad (1)$$

$$[(((\text{number of carbon atoms} \times 2) + 2) - (\text{sum of halogen atoms}))]$$

$$\text{For example,} \quad (2)$$

bromotrifluoromethane – CF₃Br – Halon 1301

3.1.2 *non-condensable gases*—non-condensable gases consist primarily of air (nitrogen, oxygen) accumulated in the vapor phase of a liquefied compressed gas where the solubility of air in the liquid phase is extremely low and air is not significant as a liquid phase contaminant. Non-condensable gases are in some instances termed *non-absorbable gases*.

4. Material Requirements

4.1 *Type I*—Mixtures of Halon 1301 and nitrogen:

4.1.1 The nitrogen (N₂) partial pressure shall be such that the safe working pressure of the receiving vessel is not exceeded. To prevent excessive pressure, the fill density of the

Halon 1301 within a container should not exceed that needed to achieve complete filling of the container at the maximum envisaged storage temperature. For example, for a U.S. DOT 4BA 500 cylinder, the nitrogen partial pressure shall not exceed 161 psi at 70 °F [12.1 bar at 21 °C] for a 70 lb/ft³ [1121 kg/m³] fill density, which yields a total pressure of 360 psig at 70 °F [25.8 bar at 21 °C]. For this example, the safe working pressure of the 4BA500 cylinder is not exceeded for temperatures below 130 °F [54 °C]. (See Practice D5631.) (See Fig. 1.)

4.1.2 Halon 1301 shall conform to the requirements prescribed in Table 1 when tested by the appropriate test method(s) listed in Section 6.

4.1.3 When a material analysis is required, by agreement between the purchaser and the supplier, the total pressure in the Halon 1301 container, partial pressure of the N₂, the fill density of the Halon 1301 within the container, and the maximum safe storage temperature shall be part of the material analysis (certification). The pressure shall be reported in pound-force per square inch gauge (preferred) or bar. The fill density shall be reported in pounds per cubic foot at 70 °F (preferred) or kilograms per cubic metre at 21 °C. The maximum safe storage temperature of the Halon 1301 container shall be reported in degrees Fahrenheit (preferred) or in degrees Celsius and shall conform to applicable regulations for the Halon 1301 container design and use.

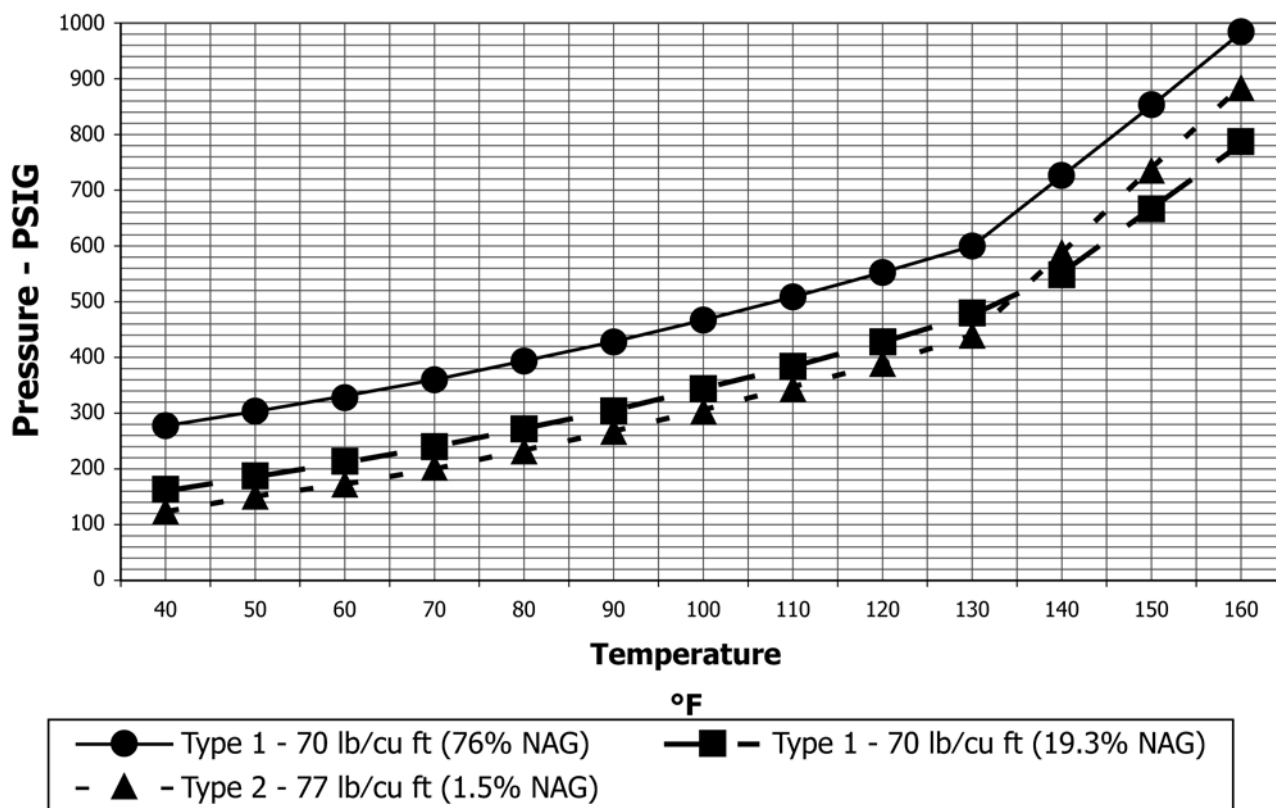


FIG. 1 Isometric Diagram for Bromotrifluoromethane