



Designation: E519/E519M – 22

Standard Test Method for Diagonal Tension (Shear) in Masonry Assemblages¹

This standard is issued under the fixed designation E519/E519M; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon (ϵ) indicates an editorial change since the last revision or reapproval.

1. Scope*

1.1 This test method covers determination of the diagonal tensile or shear strength of masonry assemblages by loading them in compression along one diagonal (see Fig. 1), thus causing a diagonal tension failure with the specimen splitting apart parallel to the direction of load.

1.2 **Annex A1** provides requirements regarding the determination of the diagonal-tension strength of masonry under combined diagonal-tension and compressive loading.

1.3 The text of this standard refers to notes and footnotes that provide explanatory material. These notes and footnotes (excluding those in tables and figures) shall not be considered as requirements of the standard.

1.4 These test methods cover the application of the tests using either inch-pound or SI units. The values stated in either SI units or inch-pound units are to be regarded separately as standard. Within the text, the inch-pound units are shown in brackets. The values stated in each system may not be exact equivalents; therefore, each system shall be used independently of the other. Combining values from the two systems may result in nonconformance with the standard.

1.5 *This standard may involve hazardous materials, operations, and equipment. This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety, health, and environmental practices and determine the applicability of regulatory limitations prior to use.*

1.6 *This international standard was developed in accordance with internationally recognized principles on standardization established in the Decision on Principles for the Development of International Standards, Guides and Recommendations issued by the World Trade Organization Technical Barriers to Trade (TBT) Committee.*

¹ This test method is under the jurisdiction of ASTM Committee C15 on Manufactured Masonry Units and is the direct responsibility of Subcommittee C15.04 on Research.

Current edition approved Dec. 1, 2022. Published December 2022. Originally approved 1974. Last previous edition approved in 2021 as E519/E519M – 21. DOI: 10.1520/E0519_E0519M-22.

2. Referenced Documents

2.1 *ASTM Standards:*²

- C67/C67M Test Methods for Sampling and Testing Brick and Structural Clay Tile
- C109/C109M Test Method for Compressive Strength of Hydraulic Cement Mortars (Using 2-in. or [50 mm] Cube Specimens)
- C140/C140M Test Methods for Sampling and Testing Concrete Masonry Units and Related Units
- C1019 Test Method for Sampling and Testing Grout for Masonry
- E4 Practices for Force Calibration and Verification of Testing Machines
- E575 Practice for Reporting Data from Structural Tests of Building Constructions, Elements, Connections, and Assemblies

3. Significance and Use

3.1 This test method was developed to measure more accurately the diagonal tensile (shear) strength of masonry than was possible with other available methods. The specimen size was selected as being the smallest that would be reasonably representative of a full-size masonry assemblage and that would permit the use of testing machines such as are used by many laboratories.

NOTE 1—As a research test method used only for the purpose of evaluating the effects of variables such as type of masonry unit, mortar, workmanship, etc., a smaller size specimen could be used if the available testing equipment will not accommodate a 1.2-m [4-ft] square specimen. However, there is a lack of experimental data that would permit an evaluation of the effect of specimen size on the shear strength or to permit a correlation between the results of small-scale specimen tests and larger specimens.

4. Apparatus

4.1 *Testing Machine:*

4.1.1 The testing machine shall have sufficient compressive load capacity and provide the rate of loading prescribed in 6.4. The machine shall be power-operated and capable of applying the load continuously, rather than intermittently, and without

² For referenced ASTM standards, visit the ASTM website, www.astm.org, or contact ASTM Customer Service at service@astm.org. For *Annual Book of ASTM Standards* volume information, refer to the standard's Document Summary page on the ASTM website.

*A Summary of Changes section appears at the end of this standard



Example of Apparatus for Vertical Specimen



Example of Apparatus for Horizontal Specimen

FIG. 1 Apparatus for Determination of Diagonal Tensile or Shear Strength Masonry Assemblages

shock. The machine shall conform to the requirements of the Calculation and Report sections of Practices E4.

4.1.2 Testing machines are permitted to accommodate the application of load in either a vertical or horizontal orientation. For horizontal test configurations, rigid steel rollers shall be provided at a spacing no greater than 400 mm [16 in.], allowing for unimpeded movement of test specimen under load in the plane of the direction of loading.

NOTE 2—In order to accommodate a 1.2-m [4-ft] square specimen placed in the machine so that the specimen diagonal is oriented parallel to the primary axis of the test machine and loading direction, the machine should have a clear opening height of at least 2.13 m [7 ft].

4.2 *Loading Shoes*—Two steel loading shoes (see Fig. 2 and Fig. 3) shall be used to apply the machine load to the specimen.

NOTE 3—Experimental work has indicated that the length of bearing of the shoe should be approximately $\frac{1}{8}$ the length of the edge of the specimen to avoid excessive bearing stress.

5. Test Specimens

5.1 *Size*—The nominal size of each specimen shall not be less than 1.2 by 1.2 m [4 by 4 ft] by the thickness of the wall type being tested. The height and length of each specimen shall be within 6 mm [0.25 in.] of each other.

5.2 *Number of Specimens*—Tests shall be made on at least three like specimens constructed with the same size and type of masonry units, mortar, and workmanship.

5.3 *Curing*—After construction, specimens shall not be moved for at least 7 days. They shall be stored in laboratory air for not less than 28 days. The laboratory shall be maintained at

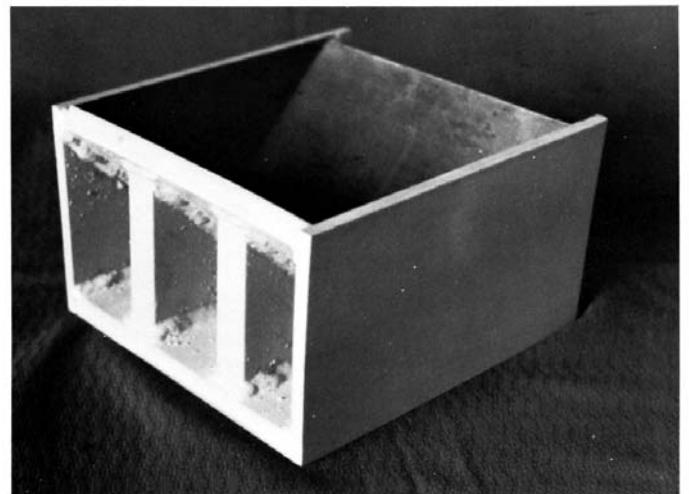


FIG. 2 Loading Shoe (Two Required)

a temperature of $24 \pm 8^\circ\text{C}$ [$75 \pm 15^\circ\text{F}$] with relative humidities between 25 and 75 %, and shall be free of drafts.

5.4 *Mortar*—Three 50-mm [2-in.] compressive strength cubes shall be molded from a sample of each batch of mortar used to build the specimens and stored under the same conditions as the specimens with which they are associated. The tests shall be conducted in accordance with Test Method C109/C109M. The cubes shall be tested on the same day as the specimen.